


BCI184G - Technical Data Sheet



BCI184G

SPECIFICATIONS & OPTIONS

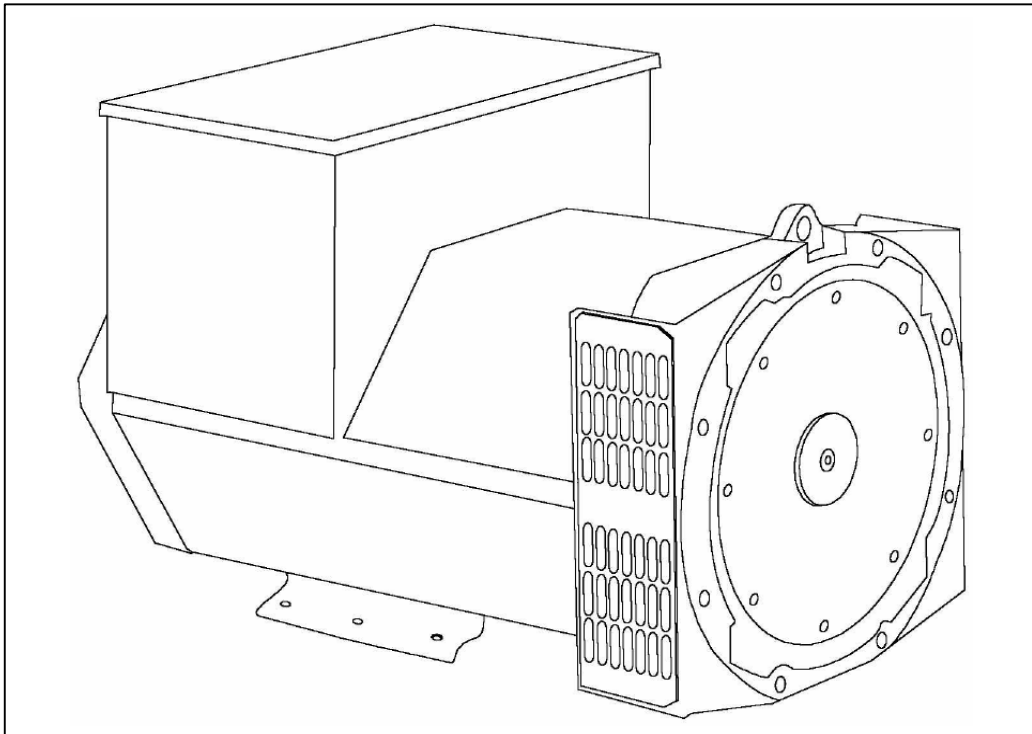

STANDARDS

Newage Stamford industrial generators meet the requirements of BS EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100, AS1359.

Other standards and certifications can be considered on request.

VOLTAGE REGULATORS

SX460 AVR - STANDARD

With this self excited control system the main stator supplies power via the Automatic Voltage Regulator (AVR) to the exciter stator. The high efficiency semiconductors of the AVR ensure positive build-up from initial low levels of residual voltage.

The exciter rotor output is fed to the main rotor through a three phase full wave bridge rectifier. This rectifier is protected by a surge suppressor against surges caused, for example, by short circuit.

SA465 AVR

The SA465 shares all the features of the SX460, but additionally will support a range of electronic accessories, such as a 'droop' Current Transformer (CT) to permit parallel operation with other ac generators.

Voltage regulation is improved by use of this AVR.

SX421 AVR

When the SX421 AVR is supplied for use with a BC generator, it will be supplied loose for fitting in the set builder's control panel.

This AVR also operates in a self-excited system. It combines all the features of the SA465 with, additionally, three-phase rms sensing for improved regulation and performance. Over voltage protection is provided via a separate circuit breaker. An engine relief load acceptance feature is built in as standard.

WINDINGS & ELECTRICAL PERFORMANCE

All generator stators are wound to 2/3 pitch. This eliminates triplen (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimum design for trouble-free supply of non-linear loads. The 2/3 pitch design avoids excessive neutral currents sometimes seen with higher winding pitches, when in parallel with the mains. A fully connected damper winding reduces oscillations during paralleling. This winding, with the 2/3 pitch and carefully selected pole and tooth designs, ensures very low waveform distortion.

TERMINALS & TERMINAL BOX

Standard generators are 3-phase reconnectable with 12 ends brought out to the terminals, which are mounted on a cover at the non-drive end of the generator. A sheet steel terminal box contains the AVR and provides ample space for the customers' wiring and gland arrangements. It has removable panels for easy access.

SHAFT & KEYS

All generator rotors are dynamically balanced to better than BS6861:Part 1 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.

INSULATION/IMPREGNATION

The insulation system is class 'H'.

All wound components are impregnated with materials and processes designed specifically to provide the high build required for static windings and the high mechanical strength required for rotating components.

QUALITY ASSURANCE

Generators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

The stated voltage regulation may not be maintained in the presence of certain radio transmitted signals. Any change in performance will fall within the limits of Criteria 'B' of EN 61000-6-2:2001. At no time will the steady-state voltage regulation exceed 2%.

NB Continuous development of our products entitles us to change specification details without notice, therefore they must not be regarded as binding.

Front cover drawing typical of product range.

BCI184G WINDING 311

CONTROL SYSTEM	SELF EXCITED		
A.V.R.	STANDARD SX460	OPTIONAL SA465	SX421 (SUPPLIED LOOSE)
VOLTAGE REGULATION	± 1.5 %	± 1.0 %	± 0.5 %
SUSTAINED SHORT CIRCUIT	SELF EXCITED MACHINES DO NOT SUSTAIN A SHORT CIRCUIT CURRENT		





INSULATION SYSTEM	CLASS H							
PROTECTION	IP23							
RATED POWER FACTOR	0.8							
STATOR WINDING	DOUBLE LAYER CONCENTRIC							
WINDING PITCH	TWO THIRDS							
WINDING LEADS	12							
STATOR WDG. RESISTANCE	0.214 Ohms PER PHASE AT 22°C SERIES STAR CONNECTED							
ROTOR WDG. RESISTANCE	0.83 Ohms at 22°C							
EXCITER STATOR RESISTANCE	22 Ohms at 22°C							
EXCITER ROTOR RESISTANCE	0.115 Ohms PER PHASE AT 22°C							
R.F.I. SUPPRESSION	BS EN 61000-6-2 & BS EN 61000-6-4, VDE 0875G, VDE 0875N. refer to factory for others							
WAVEFORM DISTORTION	NO LOAD < 1.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%							
MAXIMUM OVERSPEED	2250 Rev/Min							
BEARING DRIVE END	BALL. 6309 - 2RS. (ISO)							
BEARING NON-DRIVE END	BALL. 6306 - 2RS. (ISO)							
	1 BEARING				2 BEARING			
WEIGHT COMP. GENERATOR	167 kg				170 kg			
WEIGHT WOUND STATOR	64.3 kg				64.3 kg			
WEIGHT WOUND ROTOR	55.98 kg				56.76 kg			
WR ² INERTIA	0.22 kgm ²				0.22 kgm ²			
SHIPPING WEIGHTS in a crate	172 kg				180 kg			
PACKING CRATE SIZE	84 x 59 x 75 (cm)				84 x 59 x 75 (cm)			
	50 Hz				60 Hz			
TELEPHONE INTERFERENCE	THF<2%				TIF<50			
COOLING AIR	0.095 m ³ /sec 200 cfm				0.119 m ³ /sec 250 cfm			
VOLTAGE SERIES STAR	380/220	400/231	415/240	440/254	416/240	440/254	460/266	480/277
VOLTAGE PARALLEL STAR	190/110	200/115	208/120	220/127	208/120	220/127	230/133	240/138
VOLTAGE SERIES DELTA	220/110	230/115	240/120	254/127	240/120	254/127	266/133	277/138
kVA BASE RATING FOR REACTANCE VALUES	31.3	31.3	31.3	27.5	35	37.5	37.5	37.5
X _d DIR. AXIS SYNCHRONOUS	1.729	1.560	1.449	1.467	1.938	1.857	1.699	1.560
X' _d DIR. AXIS TRANSIENT	0.166	0.150	0.139	0.141	0.199	0.190	0.174	0.160
X'' _d DIR. AXIS SUBTRANSIENT	0.122	0.110	0.102	0.104	0.124	0.119	0.109	0.100
X _q QUAD. AXIS REACTANCE	0.864	0.780	0.725	0.734	0.957	0.916	0.838	0.770
X'' _q QUAD. AXIS SUBTRANSIENT	0.188	0.170	0.158	0.159	0.211	0.202	0.185	0.170
X _L LEAKAGE REACTANCE	0.070	0.063	0.059	0.059	0.078	0.075	0.069	0.063
X ₂ NEGATIVE SEQUENCE	0.155	0.140	0.130	0.132	0.186	0.179	0.163	0.150
X ₀ ZERO SEQUENCE	0.074	0.067	0.062	0.063	0.083	0.080	0.073	0.067
REACTANCES ARE SATURATED VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED								
T' _d TRANSIENT TIME CONST.	0.024 s							
T'' _d SUB-TRANSTIME CONST.	0.006 s							
T' _{do} O.C. FIELD TIME CONST.	0.55 s							
T _a ARMATURE TIME CONST.	0.007 s							
SHORT CIRCUIT RATIO	1/X _d							

**50
Hz**





BCI184G
Winding 311



THREE PHASE EFFICIENCY CURVES

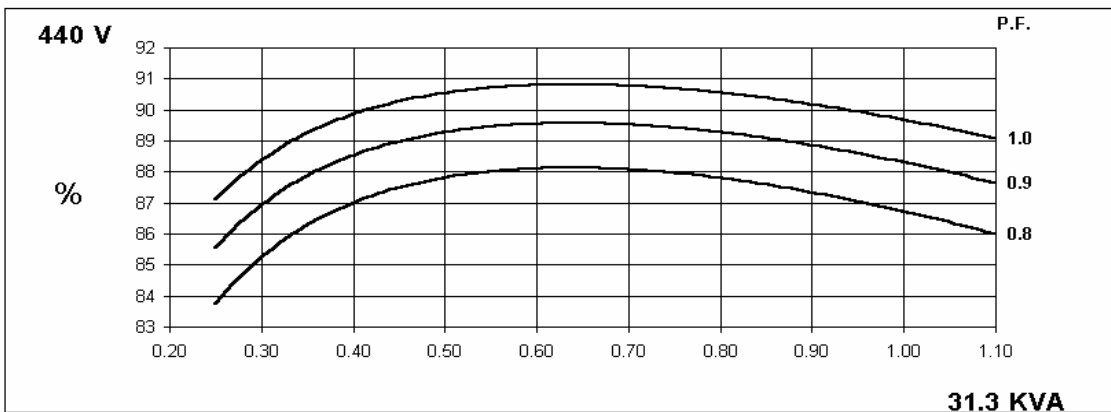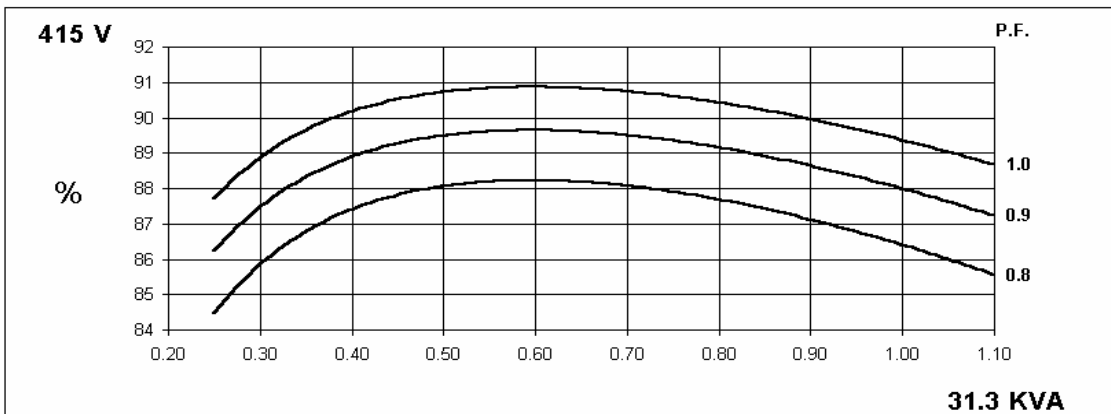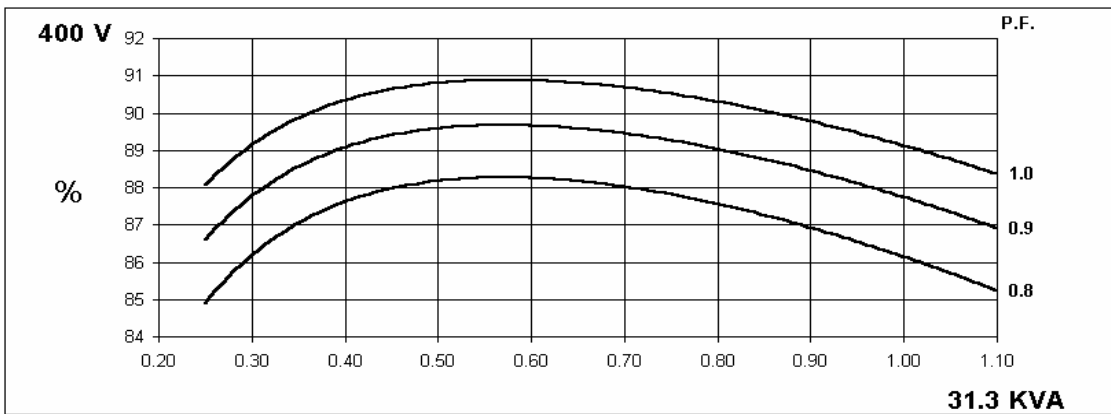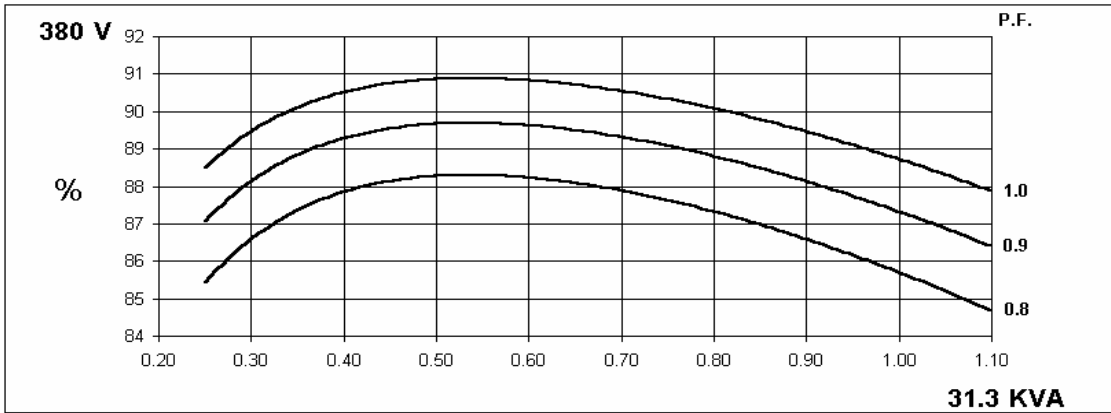

THREE PHASE EFFICIENCY CURVES

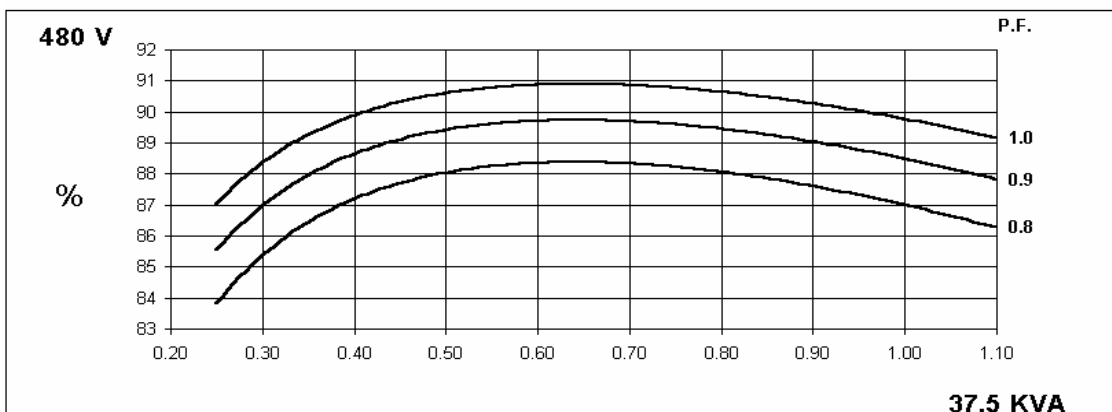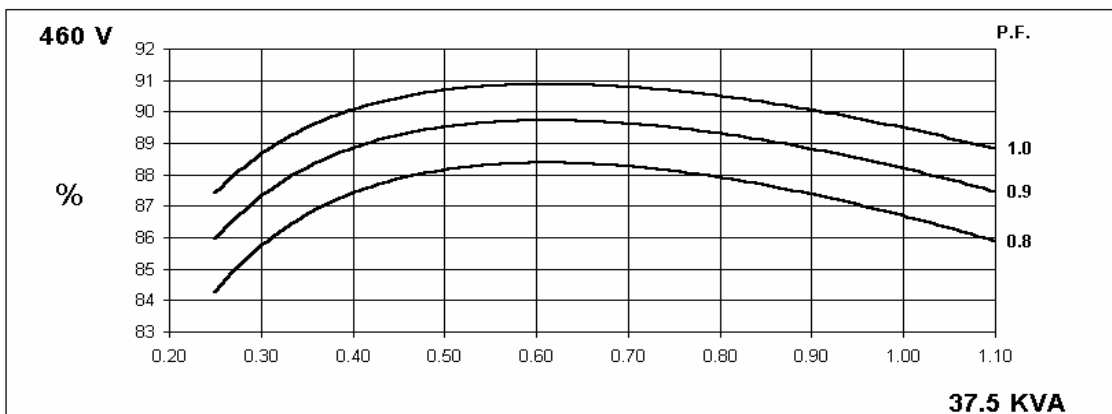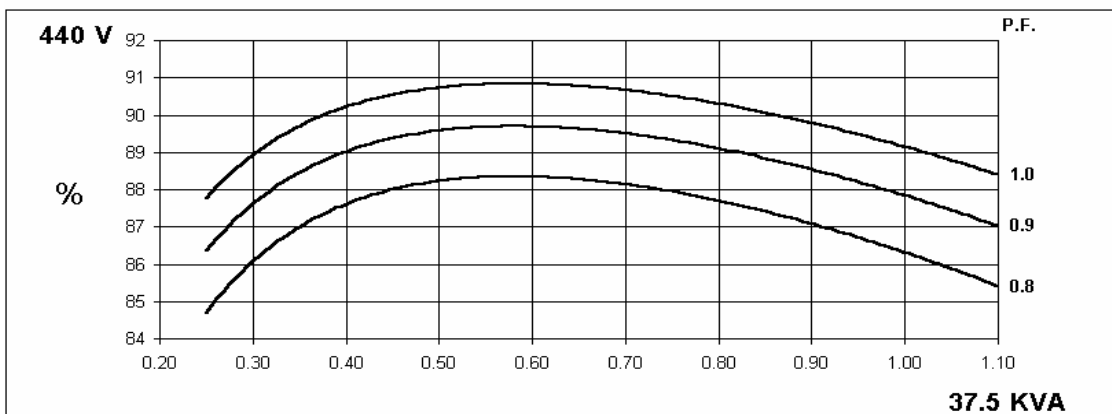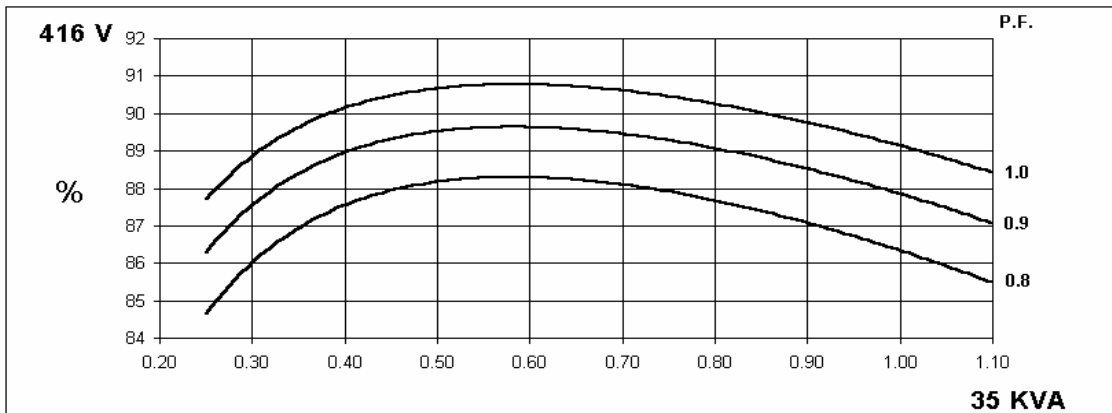


BCI184G
Winding 311




Locked Rotor Motor Starting Curve

**50
Hz**

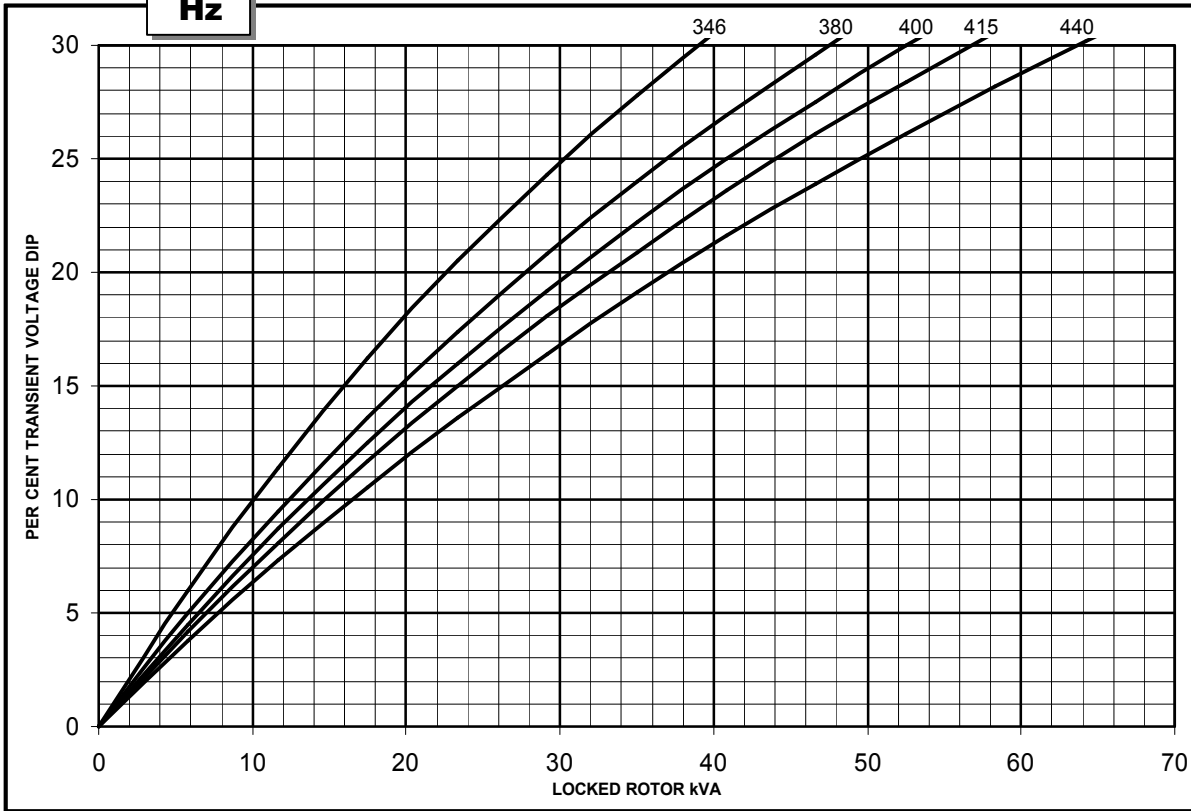

**60
Hz**

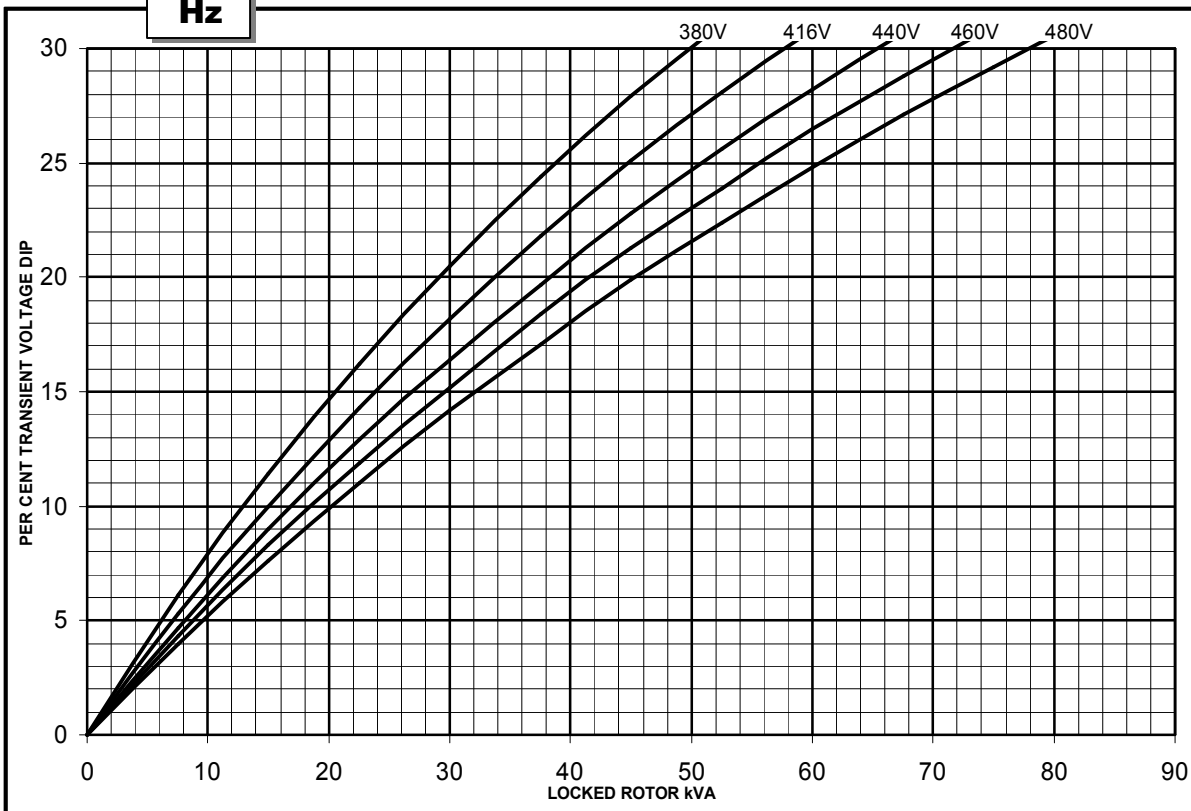

Page left blank intentionally

BCI184G

Winding 311 / 0.8 Power Factor




RATINGS

Class - Temp Rise		Cont. F - 105/40°C				Cont. H - 125/40°C				Standby - 150/40°C				Standby - 163/27°C			
50 Hz	Series Star (V)	380	400	415	440	380	400	415	440	380	400	415	440	380	400	415	440
	Parallel Star (V)	190	200	208	220	190	200	208	220	190	200	208	220	190	200	208	220
	Series Delta (V)	220	230	240	254	220	230	240	254	220	230	240	254	220	230	240	254
	kVA	29.0	29.0	29.0	25.5	31.3	31.3	31.3	27.5	32.5	32.5	32.5	28.6	33.0	33.0	33.0	29.0
	kW	23.2	23.2	23.2	20.4	25.0	25.0	25.0	22.0	26.0	26.0	26.0	22.9	26.4	26.4	26.4	23.2
	Efficiency (%)	86.4	86.7	87.0	87.2	85.7	86.2	86.4	86.7	85.3	85.8	86.1	87.3	85.2	85.7	86.0	87.2
	kW Input	26.9	26.8	26.7	26.6	29.2	29.0	29.0	28.9	30.5	30.3	30.2	26.2	31.0	30.8	30.7	26.6

60 Hz	Series Star (V)	416	440	460	480	416	440	460	480	416	440	460	480	416	440	460	480
	Parallel Star (V)	208	220	230	240	208	220	230	240	208	220	230	240	208	220	230	240
	Series Delta (V)	240	254	266	277	240	254	266	277	240	254	266	277	240	254	266	277
	kVA	31.3	34.4	34.4	34.4	35.0	37.5	37.5	37.5	36.3	38.8	38.8	38.8	36.9	40.0	40.0	40.0
	kW	25.0	27.5	27.5	27.5	28.0	30.0	30.0	30.0	29.0	31.0	31.0	31.0	29.5	32.0	32.0	32.0
	Efficiency (%)	87.1	87.0	87.3	87.5	86.3	86.3	86.7	87.0	86.0	86.0	86.4	86.8	85.9	85.7	86.2	86.5
	kW Input	28.7	31.6	31.5	31.5	32.4	34.8	34.6	34.5	33.8	36.1	35.9	35.8	34.4	37.3	37.1	37.0

DIMENSIONS

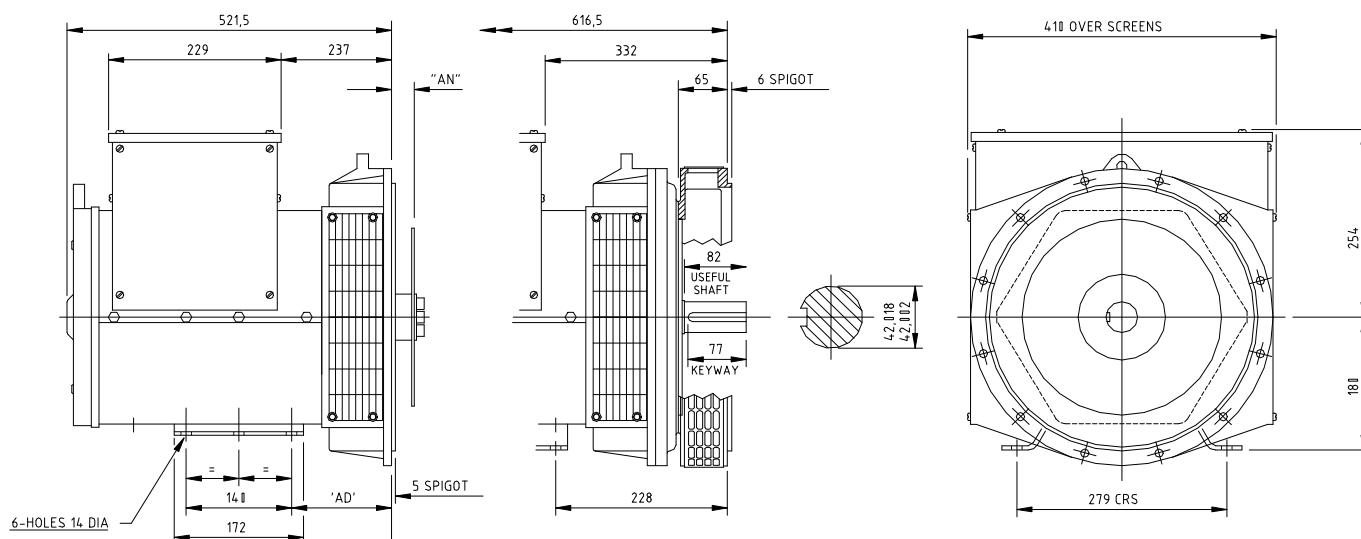

COUPLING DISC	"AN"
SAE 7,5	30,16
SAE 8	61,9
SAE 10	53,98

ADAPTOR	'AD'
SAE 2	172
SAE 3	145
SAE 4	133
SAE 5	133
SAE 6	164,7

8 HOLES SPACED AS 12

ACHIEVED WITH SPACER PLATE 31,7mm THICK



Barnack Road • Stamford • Lincolnshire • PE9 2NB
Tel: 00 44 (0)1780 484000 • Fax: 00 44 (0)1780 484100
Website: www.newage-avkseg.com