


IF IN DOUBT-ASK
DO NOT SCALE

FRAME	NETT WT. (Kg)
PI4GI	167

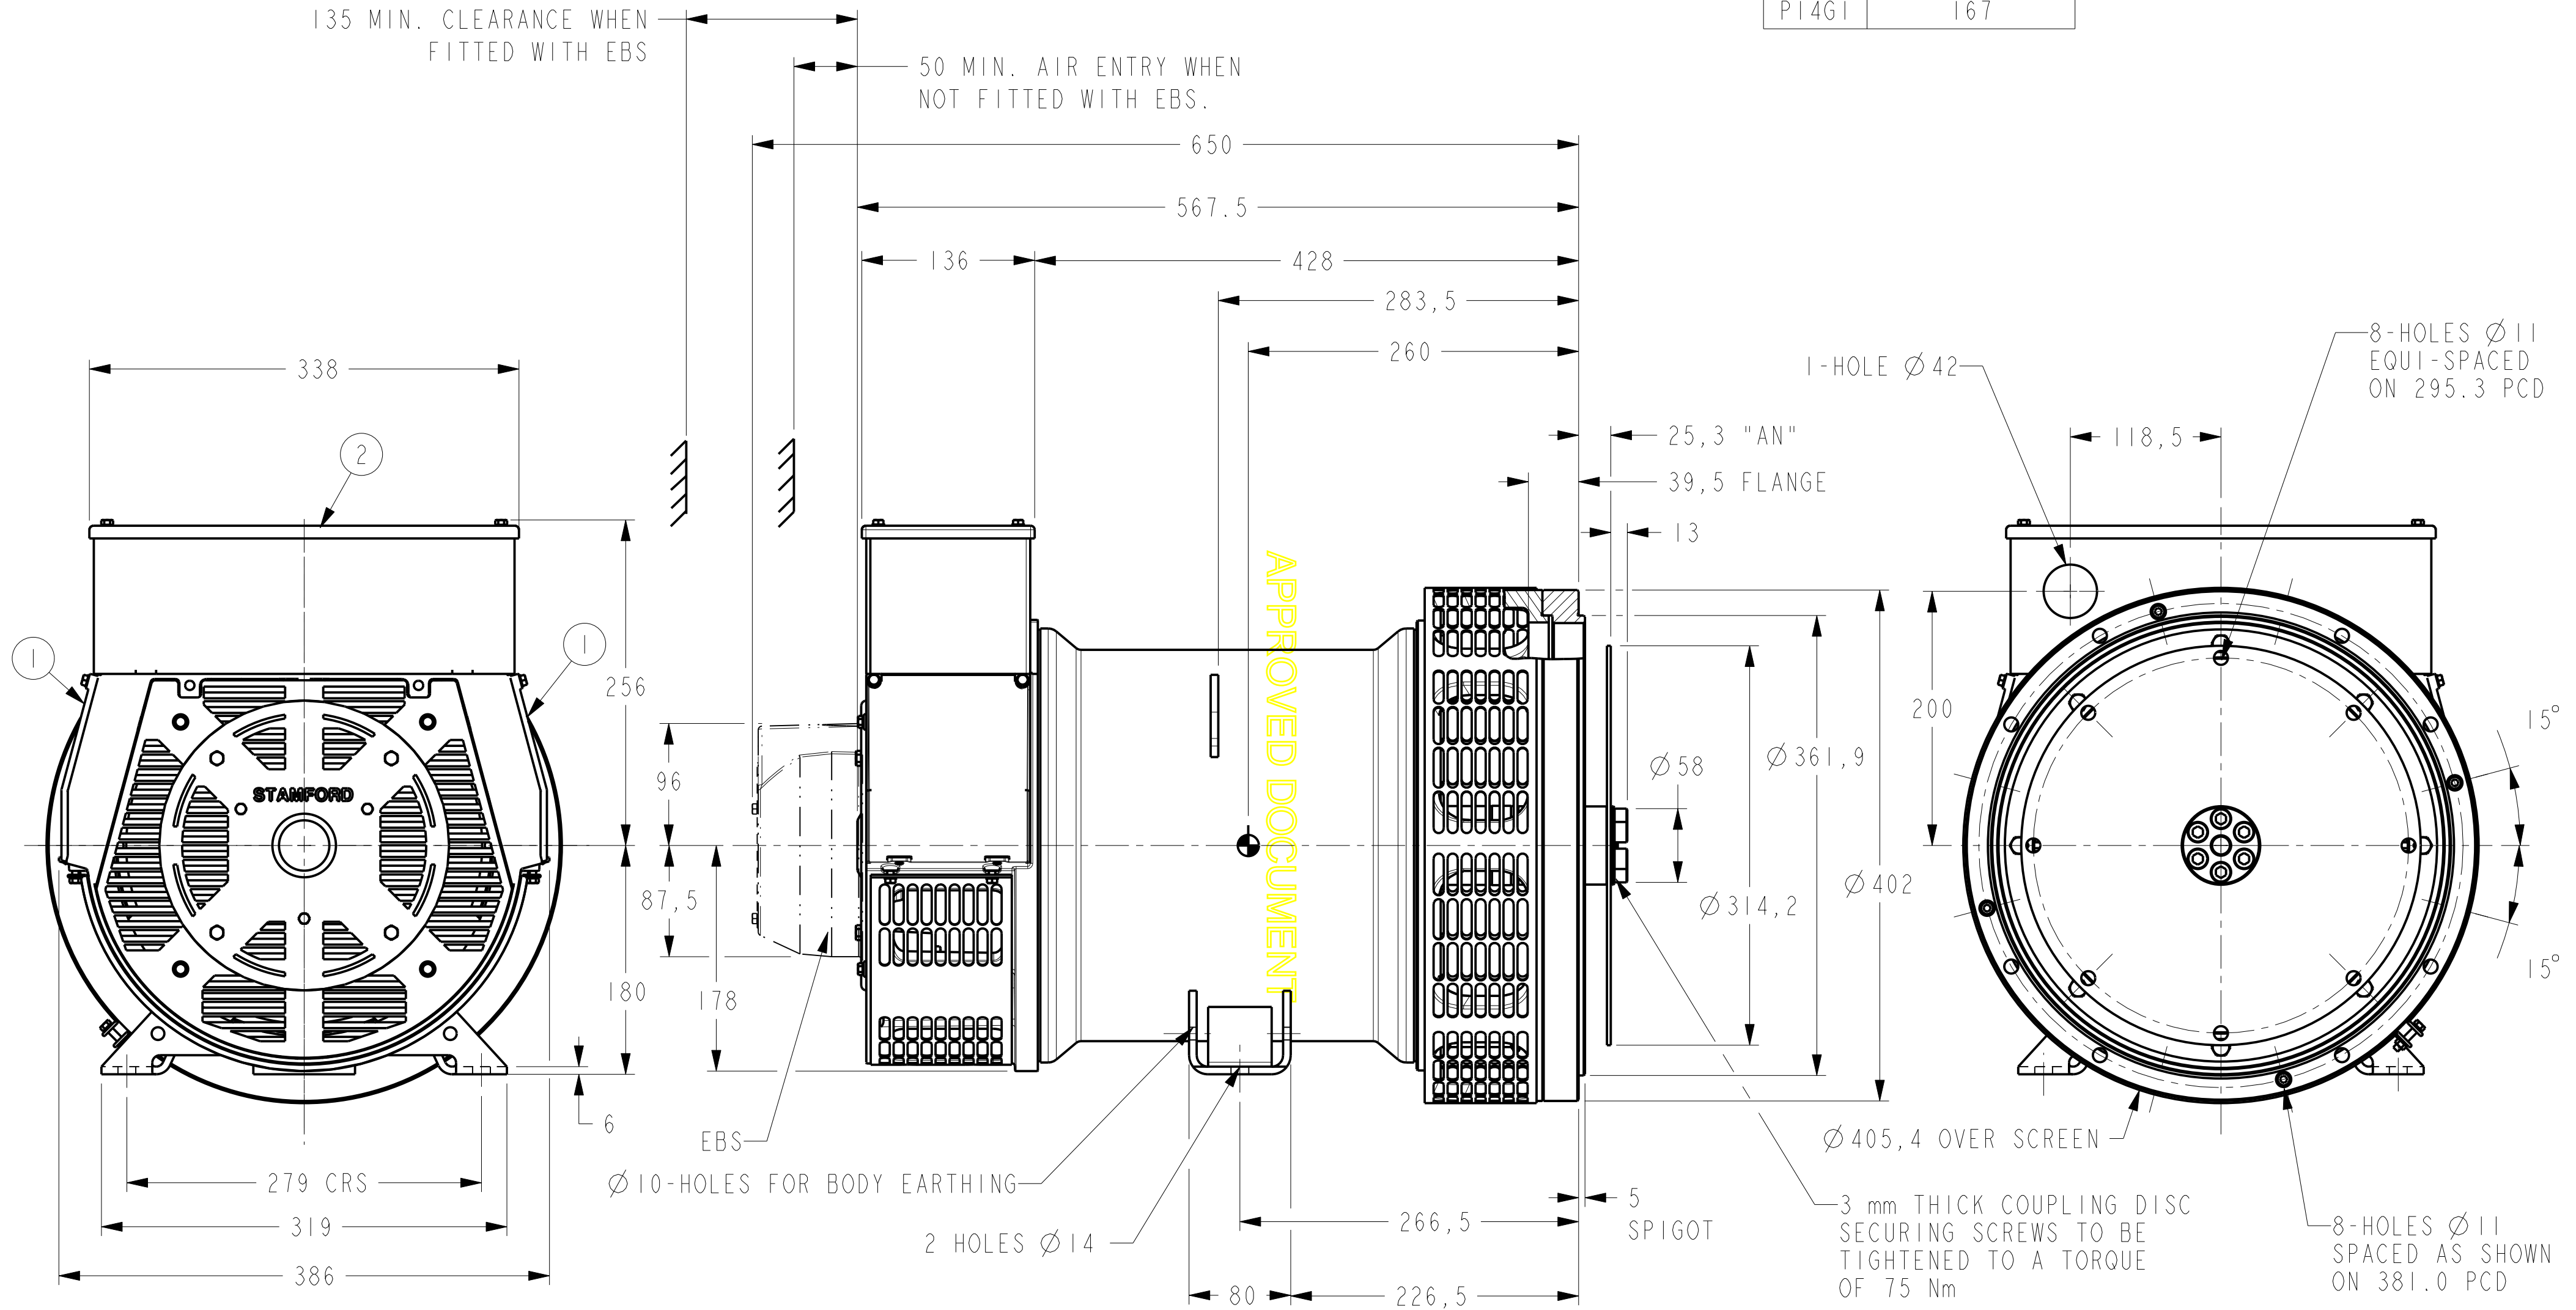


- ① -REMOVABLE COVER FOR ACCESS TO ELECTRONIC CONTROL
- ② -REMOVABLE COVER FOR ACCESS TO MAIN TERMINALS

MOD.	ISSUE	DRAWN	DATE	MODIFICATION
4-9346-46	C	BSR	07/02/08	REPLACED ADAPTOR & 39.5 FLANGE WAS 11 FLANGE
4-9346-09	B	AV	11/12/07	TERMINAL BOX CHANGED - DIMS 338, 256 WERE 300, 220 - SPACER REPLACED BY EXTENDED ADAPTOR
4-9111-29	A	DW	24/07/07	ORIGINAL ISSUE

CONFIDENTIAL PROPERTY OF
CUMMINS GENERATOR TECHNOLOGIES LTD.

PI G
1- BEARING ALTERNATOR
SAE 4 ADAPTOR - 42 DIA HOLE T/BOX
SAE 10 COUPLING WITH 25.3 "AN"
TO SUIT KOMATSU 4095L

DIMENSIONS IN MILLIMETRES
(MM) AT 20°C

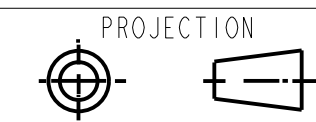

UNLIMITED DIMS ± --

DRAWN	DW	24/07/07
CHECKED	AV	11/12/07
APPROVED	SMH	11/12/07

DRG. SIZE C	SCALE 3:10
REL. PHASE P	PART No 19-1066
PRO/ENGINEER	ISSUE C
SHEET 1 OF 1 SHEETS	