


IF IN DOUBT-ASK
DO NOT SCALE

F	G	H	J	K	L	M	N	P	Q	R	S	T	U	V
195.3	58.9	104.1	178.3	198.1	106.7	11.2	104.1	177.8	200.7	46.7	157.5	134.1	38.1	200.9

FRAME	"A"	"B"	"C"	"D"	"X"	NETT WEIGHT (Kg)
PI4HI / PI2HI	723	641	341	353	340	185
PI4JI / PI2JI	753	671	371	368	355	195
PI4KI	768	686	386	374	360	205

135 MIN. CLEARANCE REQUIRED
WHEN FITTED WITH EBS

50 MIN. AIR ENTRY WHEN
NOT FITTED WITH EBS

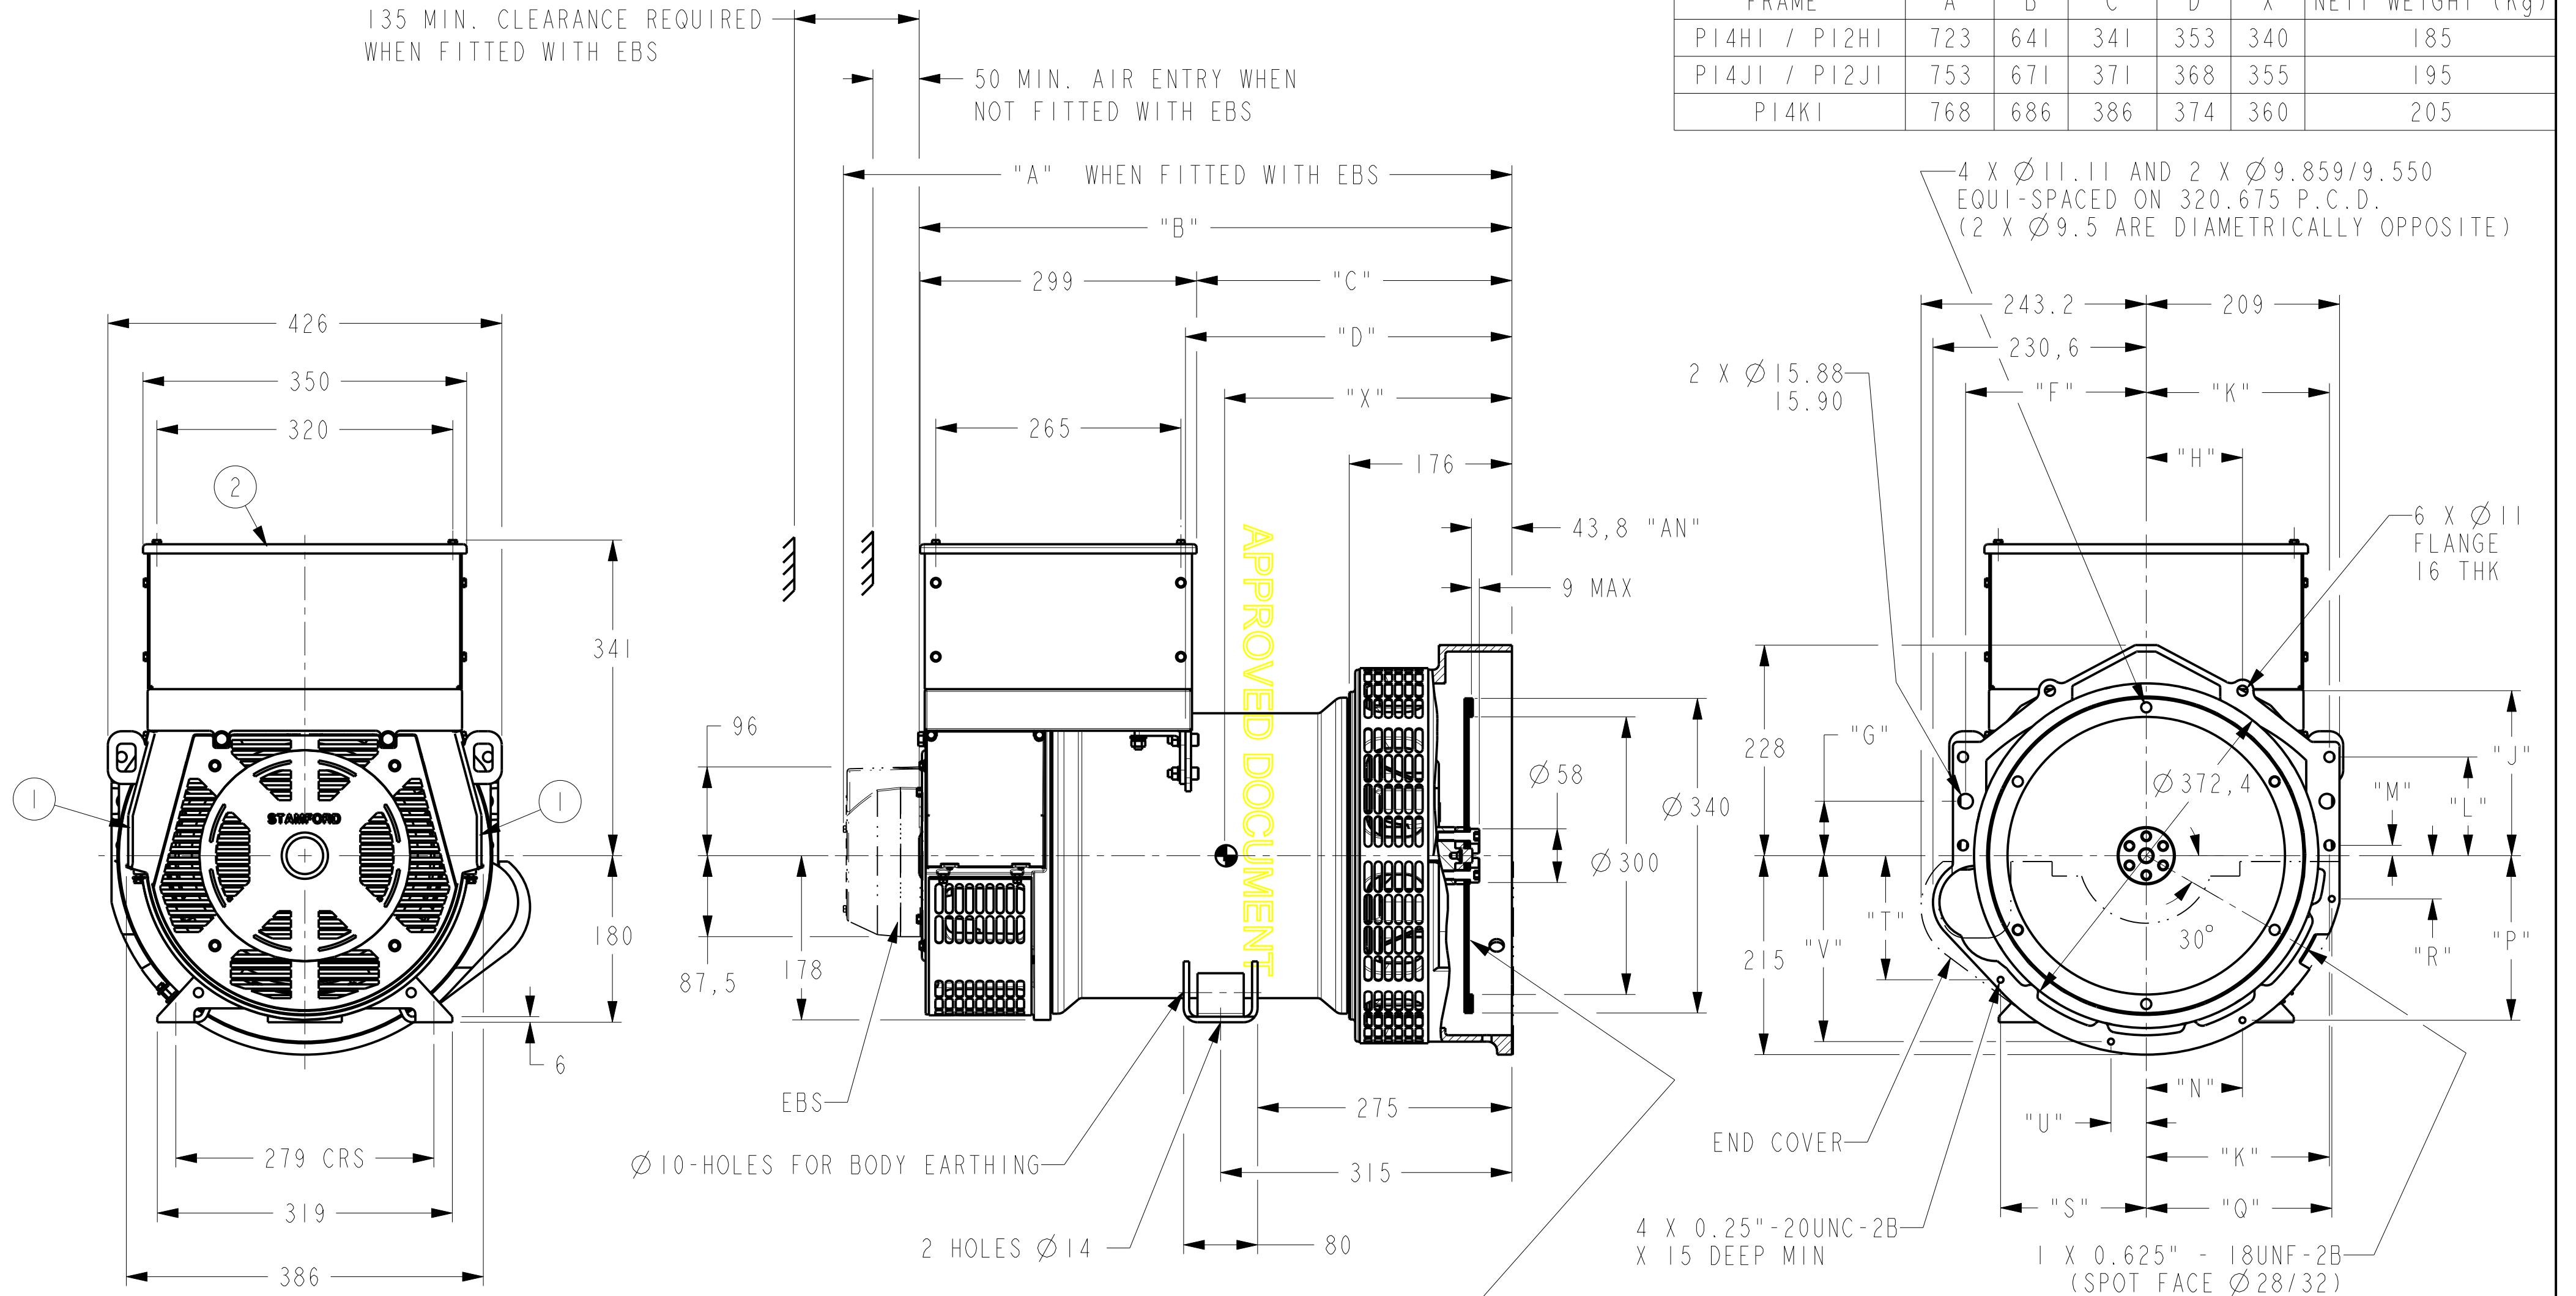

APPROVED DOCUMENT

- ① -REMOVABLE COVER FOR ACCESS TO ELECTRONIC CONTROL
- ② -REMOVABLE COVER FOR ACCESS TO MAIN TERMINALS

3 PLATE COUPLING 4.5mm THICK:3-DISC
SPACER 4.5mm THICK:TOTAL THICKNESS
9mm:HUB SECURING SCREWS TO BE
TIGHTENED TO A TORQUE OF 7.6 kgfm(75Nm)

CONFIDENTIAL		PROPERTY OF CUMMINS GENERATOR TECHNOLOGIES LTD.		PI H/J 2-POLE AND PI H/J/K 4-POLE I- BEARING ALTERNATOR WITH ADAPTOR / COUPLING TO SUIT 'GM ENGINES LARGE T/BOX - REMOVABLE SIDE PANELS	
DIMENSIONS IN MILLIMETRES (MM) AT 20°C		PROJECTION 		DRG. SIZE C	SCALE 1:5
UNLIMITED DIMS ±	--	DRAWN DW	14/2/08	REL. PHASE P	PART No 19-1126
		CHECKED DW	14/2/08	Pro/ENGINEER	ISSUE A
		APPROVED SMH	14/2/08	SHEET 1 OF 1 SHEETS	

4-9346-48	A	DW	14/2/08	ORIGINAL ISSUE
MOD.	ISSUE	DRAWN	DATE	MODIFICATION